


Smart level probes SGE-25.Smart and SGE-25S.Smart

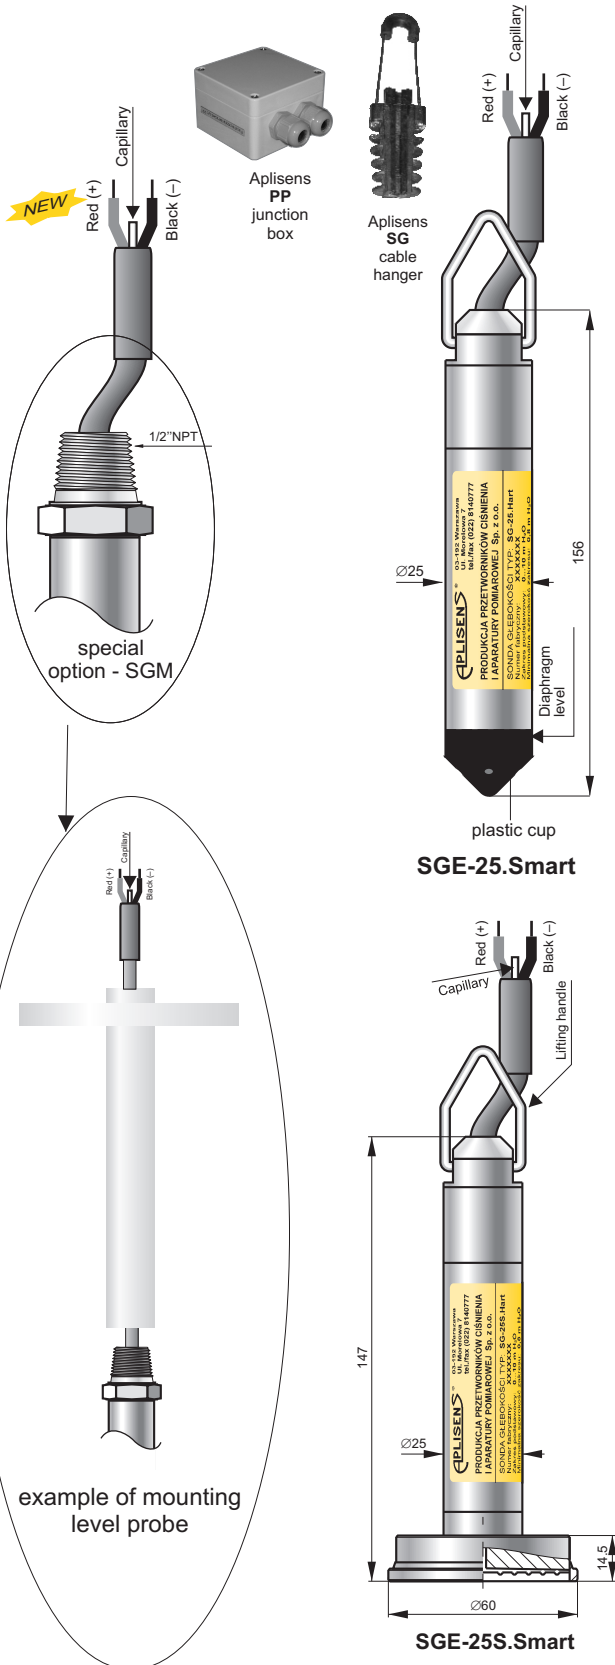

- ✓ Programmable zero shift, range and damping ratio
- ✓ 4...20 mA output signal + HART protocol
- ✓ Accuracy 0.1%
- ✓ Integrated internal overvoltage protection circuit
- ✓ ATEX Intrinsic safety Ex II 1G Ex ia IIC T4/T5/T6 Ga
II 1G Ex ia IIB T4/T5/T6 Ga (only for level probe with teflon cable)
I M1 Ex ia I Ma
- ✓ Special version with Titanium wetted parts (SGE-25S.Smart)
- ✓ Marine certificate DNV

Application

The SGE-25.Smart level probe is applicable to measure liquid levels in tanks, deep wells or piezometers.

The SGE-25S.Smart probe is applicable to measure levels of liquids containing contaminants or suspensions. A typical use for this probe is the measurement of levels of liquid waste in intermediate pumping stations, fermentation chambers, settling tanks etc.

Principles of operation, construction

The probe measures liquid levels, basing on a simple relationship between the height of the liquid column and the resulting hydrostatic pressure. The pressure measurement is carried out on the level of the separating diaphragm of the immersed probe and is related to atmospheric pressure through a capillary in the cable.

The active sensing element is a piezoresistant silicon sensor separated from the medium by an isolating diaphragm. The electronic amplifier, which works in combination with the sensor, is additionally equipped with an overvoltage protection circuit, which protects the probe from damage caused by induced interference from atmospheric discharges or from associated heavy current engineering appliances.

Configuration

The following metrological parameters can be configured:

- ◆ the units of pressure;
- ◆ start and end-points of set range;
- ◆ damping time constant;
- ◆ inverted characteristic (output signal $20 \div 4$ mA).

Calibration

It is possible to calibrate the probe in relation to a model pressure.

Communication

The communication standard for data interchange with the probe is the Hart protocol.

Communication with the probe is carried out with:

- a KAP-03 communicator,
- some other Hart type communicators,
- a PC using an HART/USB/Bluetooth converter and RAPORT 2 configuration software.

The data interchange with the probe also enables the users to:

- ◆ identify the probe;
- ◆ read the currently measured hydrostatic pressure value, output current and percentage of measuring range.

Installation, method of use

When lowered to the reference level, the probe may either hang freely on the cable or lie on the bottom of the tank. The cable with the capillary can be extended using a standard signal cable. For the cable connection a special Aplisens **SG** cable hanger is recommended. The cable connection should be situated in a non-hermetically sealed box (the internal pressure inside the box should be equal to the atmospheric pressure), preventing water or other contaminants from getting into the capillary. The Aplisens **PP** junction box is recommended. For systems with long signal transmission lines, it is recommended the using of an addi-

tional Aplisens UZ-2 overvoltage protection circuit in the form of a wall-mounted box which allows the cables connection. When the probe cable is being wound up, the minimum winding diameter should be 30cm and the cable should be protected from mechanical damage.

If there is a possibility of turbulence in the tank (for example, because of the mixer operating mixers or a turbulent inflow), the probe should be installed inside a screening tube (e.g. made of PVC). The line hooked on the lifting handle can simplify the operation of the probe pulling out. Cleaning the probe diaphragm by mechanical means is strictly prohibited.

Measuring ranges

No.	Nominal measuring range (FSO)	Minimum set range	Overpressure limit (without hysteresis)
1	0...1,5 m H ₂ O	0,15 m H ₂ O	15 m H ₂ O
2	0...10 m H ₂ O	0,8 m H ₂ O	100 m H ₂ O
3	0...100 m H ₂ O ¹⁾	8 m H ₂ O	700 m H ₂ O

¹⁾ Range available only is SGE-25.Smart

Technical data

Metrological parameters

Accuracy	≤ ±0,1% for nominal range
SGE-25.Smart	≤ ±0,3% for range 0...10% FSO
Long term stability	≤ 0,1% (FSO) for 2 years
Accuracy	≤ ±0,16% for nominal range
SGE-25S.Smart	≤ ±0,4% for range 0...10% FSO
Thermal error	< ±0,08% (FSO) / 10°C max ±0,2% in the whole compensation temp. range
For the SGE-25S.Smart probe the use of a diaphragm seal causes an additional absolute zero error, related to changes in the medium temperature, of up to 80 Pa / 10°C	
Thermal compensation range	-25...80°C
Response time	16...230ms (programmable)
Additional electronic damping	0...30s
Error due to supply voltage changes	0,002% (FSO) / V

Electrical parameters

Power supply	7,5...55 VDC (Ex 7,5...28 VDC)
Output signal	4...20 mA (two wire transmission)
Load resistance	$R[\Omega] \leq \frac{U_{sup}[V] - 7,5V}{0,0225A}$
Resistance required for communication	>240 Ω

Operating conditions

Medium temperature range	-30...40°C ETFE or PTFE version: 0...80°C
CAUTION: The medium must not be allowed to freeze in the immediate vicinity of the probe.	
Degree of protection	IP68
Material of casing and diaphragm	SS316L (for SGE-25 Smart diaphragm Hastelloy) Titanium – special version (only SGE-25S.Smart)
Cable shield	POLYURETHANE

Ordering procedure

Model	Code	Description								
SGE-25.Smart SGE-25S.Smart		Smart level probe								
Versions, certificates	/Exia..... /SGM..... /Titanium..... /MR.....	II 1G Ex ia IIC T4/T5/T6 Ga/Gb I M1 Ex ia I Ma II 1G Ex ia IIB T4/T5/T6 Ga/Gb I M1 Ex ia I Ma Version with Teflon cable shielding Version with thread on packing gland Titanium wetted parts Marine certificate (DNV), only with PU PZH cable								
Nominal measuring range	/0...1,5 m H ₂ O..... /0...10 m H ₂ O..... /0...100 mH ₂ O.....	<table border="1"> <thead> <tr> <th>Range</th> <th>Min. set range</th> </tr> </thead> <tbody> <tr> <td>0...1,5 m H₂O</td> <td>0,15 m H₂O</td> </tr> <tr> <td>0...10 m H₂O</td> <td>0,8 m H₂O</td> </tr> <tr> <td>0...100 mH₂O</td> <td>8 m H₂O</td> </tr> </tbody> </table>	Range	Min. set range	0...1,5 m H ₂ O	0,15 m H ₂ O	0...10 m H ₂ O	0,8 m H ₂ O	0...100 mH ₂ O	8 m H ₂ O
Range	Min. set range									
0...1,5 m H ₂ O	0,15 m H ₂ O									
0...10 m H ₂ O	0,8 m H ₂ O									
0...100 mH ₂ O	8 m H ₂ O									
Measuring set range	/...+... [required units]	Calibrated range in relation to 4mA and 20mA output								
Cable	/PU..... /PU PZH..... /ETFE..... /EFTE-R..... /PU + PTFE..... /ETFE + PFTE.....	Polyurethane cable (medium temp. up to 40°C) Polyurethane, halogen free cable with hygienic certification (medium temp. up to 40°C) ETFE cable (not suitable for mineral oil products, medium temp. up to 80°C) ETFE cable with Viton/silicon sealing (suitable for mineral oil products, medium temp. up to 40°C) Polyurethane cable with PTFE shielding (medium temp. up to 80°C) ETFE cable with PTFE shielding (medium temp. up to 80°C)								
Accessories	L=...m /SG..... /PP.....	Cable length Cable hanger Junction box								